


GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 22 June 2013	14,165 MW	14,359 MW	1.37%	
Energy Demand for 22 June 2013	313.05 GWh	315.22 GWh	0.69%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (14 May 2013)	345.42 GWh	344.42 GWh	-0.29%	*New Energy

Prepared by:
Electricity Market Operations
Electricity Supply & Market Regulations Dept.
Energy Commission Malaysia
23-Jun-13


Daily Owners' Mix for 22 June 2013

TNB	72,697	MWh
IPP	239,389	MWh
Co-Gen	2,318	MWh
Interconnection*	(815)	MWh

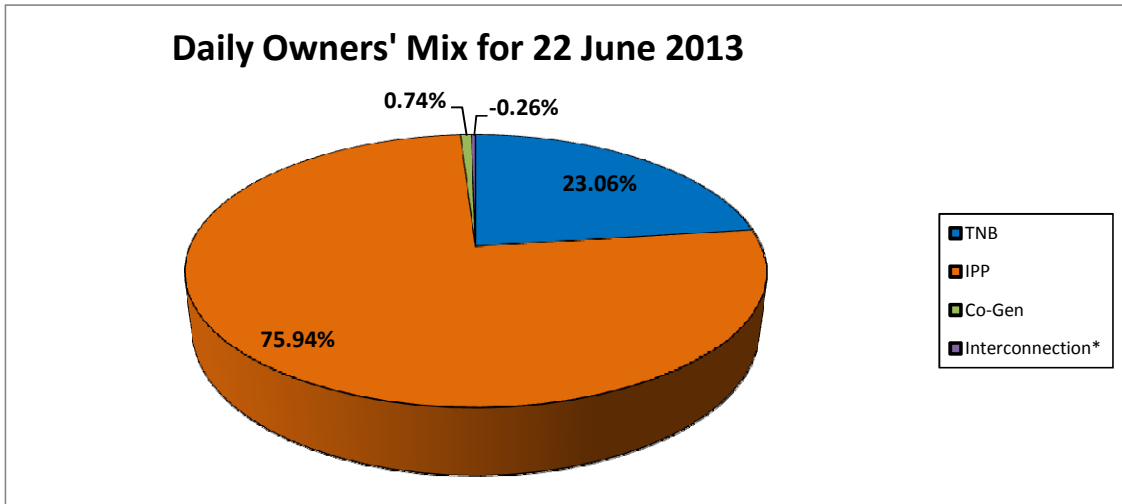

Daily Generation Mix for 22 June 2013

ST-Coal	141,078	MWh
ST-Oil	-	MWh
ST-Gas	943	MWh
Gas	160,570	MWh
Hydro	9,495	MWh
Distillate	-	MWh
Co-Gen	2,318	MWh
SPORE*	(119)	MWh
EGAT*	(696)	MWh

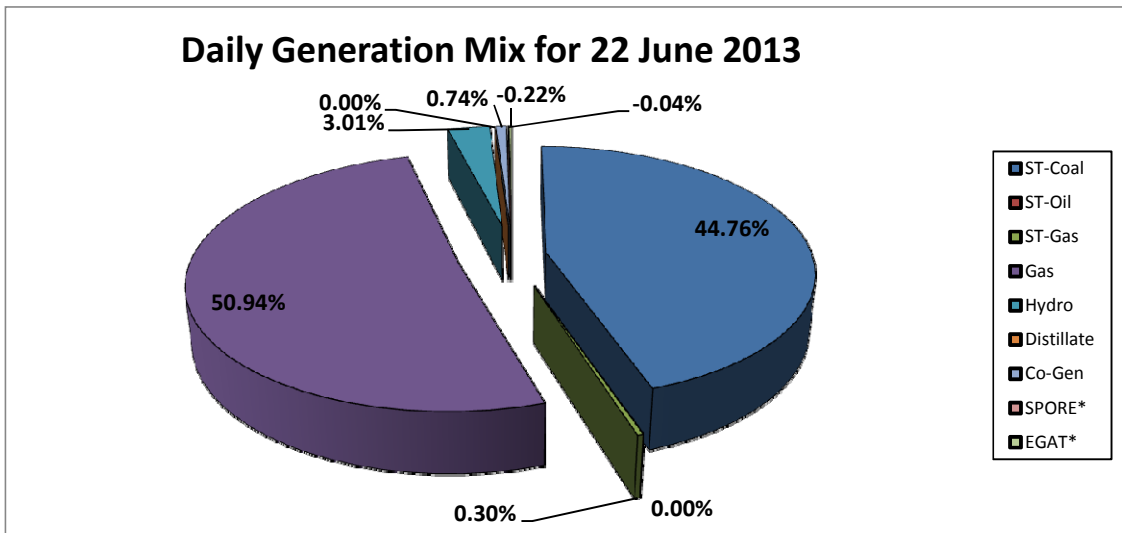

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand