

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 30 June 2013	13,635 MW	13,474 MW	-1.18%	
Energy Demand for 30 June 2013	291.61 GWh	284.27 GWh	-2.52%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

01-Jul-13


Daily Owners' Mix for 30 June 2013

TNB	48,418 MWh
IPP	235,318 MWh
Co-Gen	1,433 MWh
Interconnection*	903 MWh

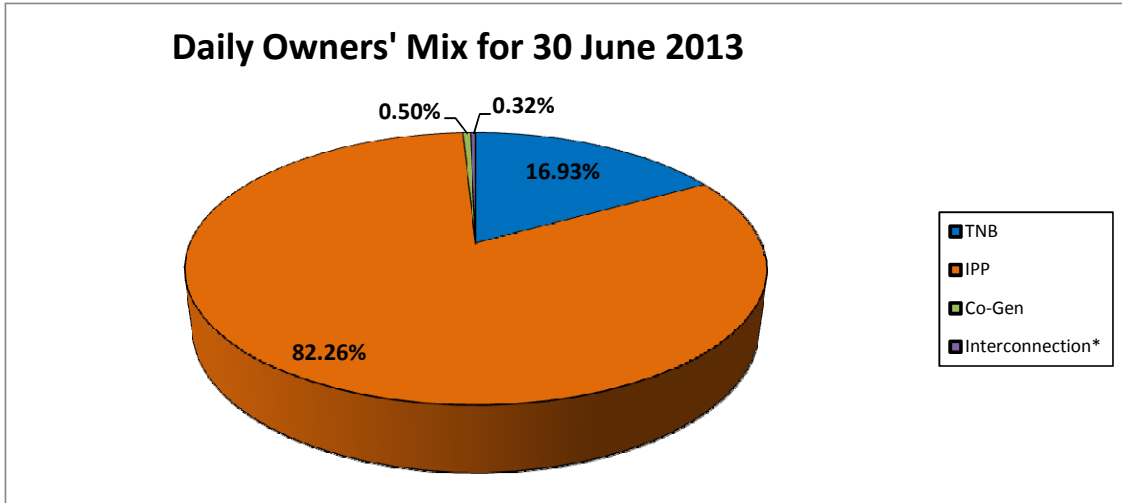

Daily Generation Mix for 30 June 2013

ST-Coal	145,386 MWh
ST-Oil	- MWh
ST-Gas	5,358 MWh
Gas	126,934 MWh
Hydro	6,058 MWh
Distillate	- MWh
Co-Gen	1,433 MWh
SPORE*	180 MWh
EGAT*	723 MWh

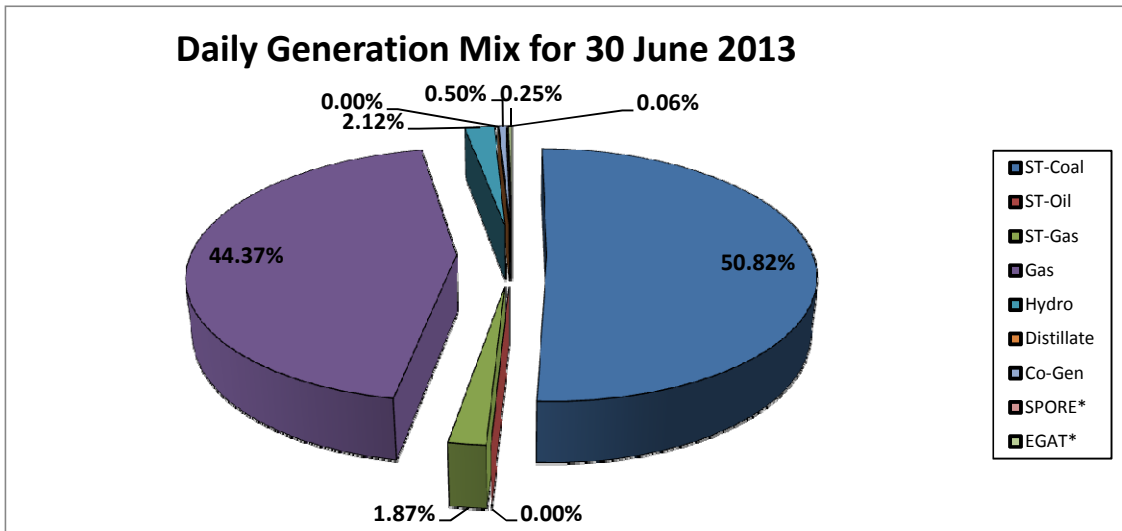

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand