

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 3 July 2013	15,653 MW	15,751 MW	0.63%	
Energy Demand for 3 July 2013	328.11 GWh	329.44 GWh	0.41%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

04-Jul-13


Daily Owners' Mix for 3 July 2013

TNB	67,182	MWh
IPP	261,590	MWh
Co-Gen	1,425	MWh
Interconnection*	754	MWh

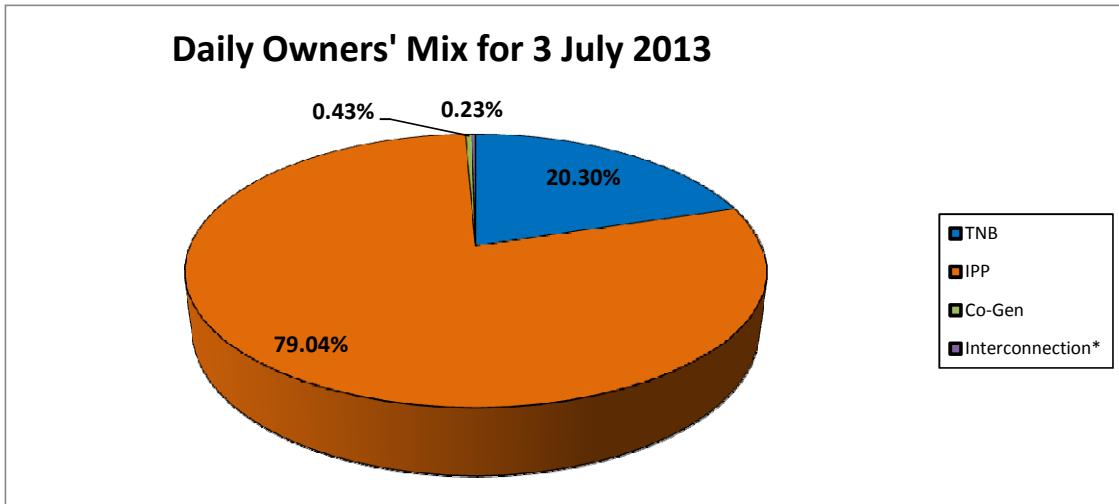

Daily Generation Mix for 3 July 2013

ST-Coal	146,632	MWh
ST-Oil	-	MWh
ST-Gas	4,650	MWh
Gas	167,091	MWh
Hydro	10,399	MWh
Distillate	-	MWh
Co-Gen	1,425	MWh
SPORE*	26	MWh
EGAT*	728	MWh

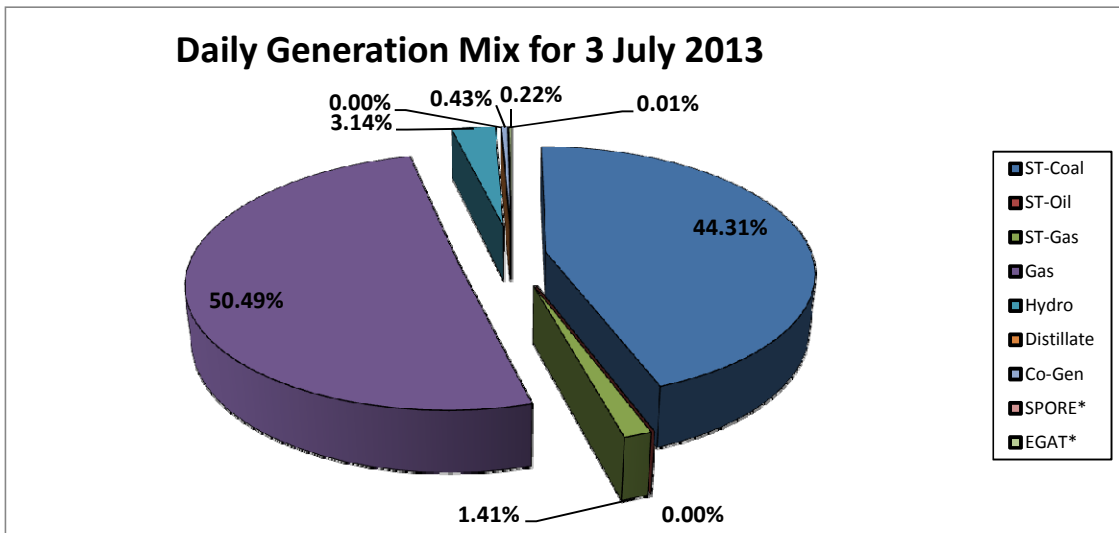

*Negative = energy is imported from Singapore and Thailand

Positive = energy is exported to Singapore and Thailand