

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 10 July 2013	15,083 MW	15,151 MW	0.45%	
Energy Demand for 10 July 2013	320.64 GWh	321.15 GWh	0.16%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

11-Jul-13


Daily Owners' Mix for 10 July 2013

TNB	52,429 MWh
IPP	267,113 MWh
Co-Gen	2,308 MWh
Interconnection*	702 MWh

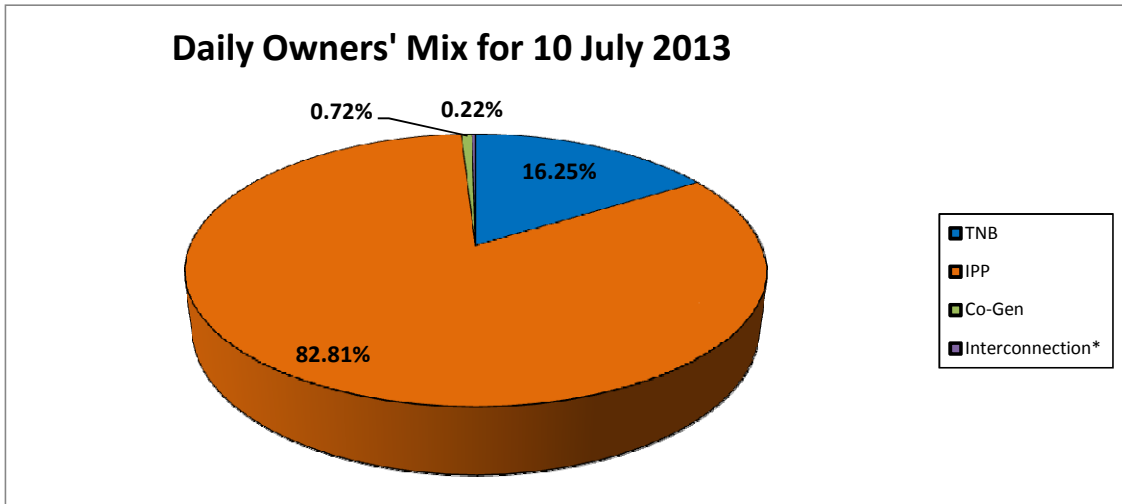

Daily Generation Mix for 10 July 2013

ST-Coal	161,374 MWh
ST-Oil	- MWh
ST-Gas	6,797 MWh
Gas	141,379 MWh
Hydro	9,992 MWh
Distillate	- MWh
Co-Gen	2,308 MWh
SPORE*	(21) MWh
EGAT*	723 MWh

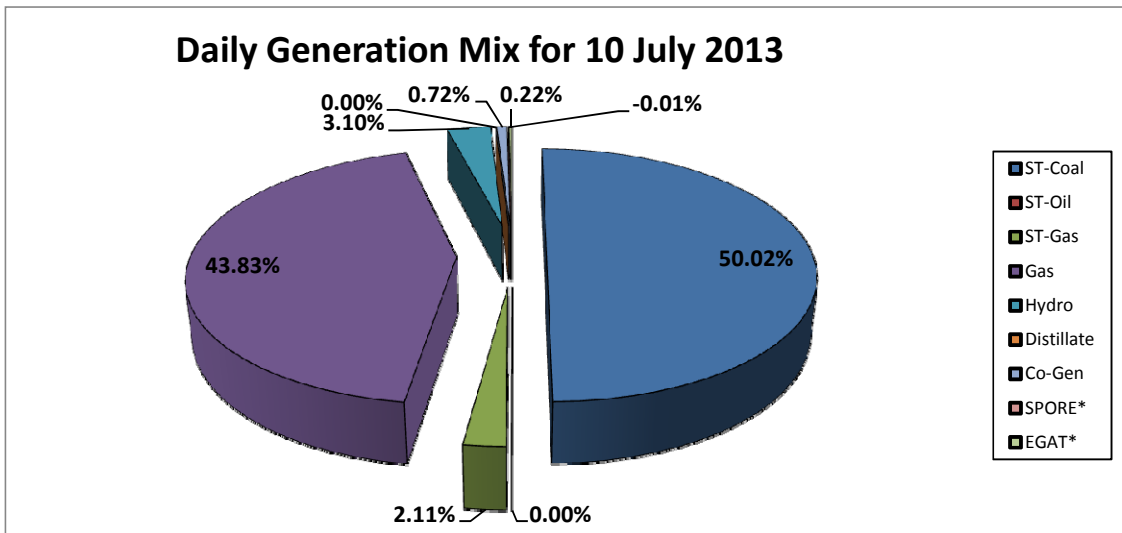

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand