

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 15 July 2013	15,401 MW	15,030 MW	-2.41%	
Energy Demand for 15 July 2013	316.97 GWh	311.40 GWh	-1.76%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

16-Jul-13


Daily Owners' Mix for 15 July 2013

TNB	64,707	MWh
IPP	244,169	MWh
Co-Gen	2,291	MWh
Interconnection*	(228)	MWh

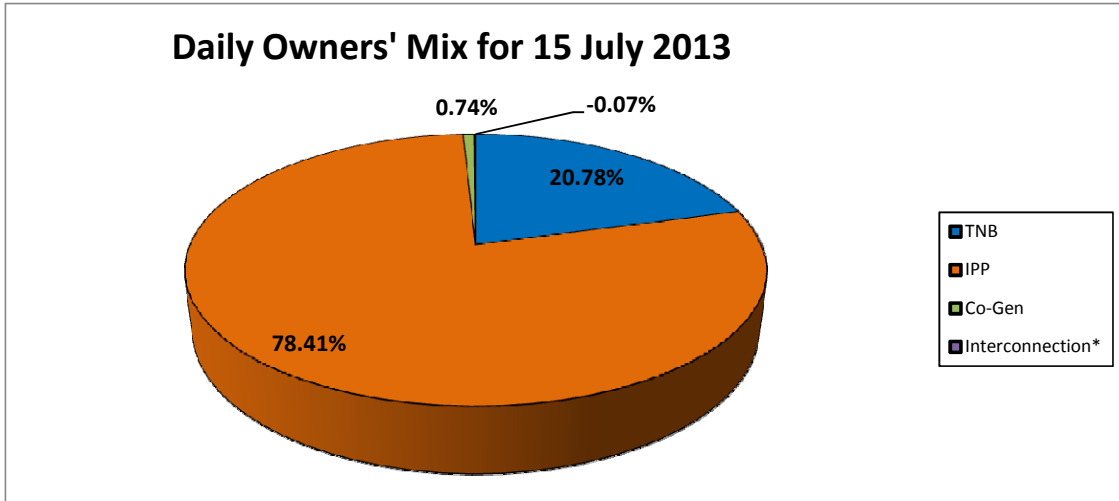

Daily Generation Mix for 15 July 2013

ST-Coal	144,202	MWh
ST-Oil	-	MWh
ST-Gas	11,127	MWh
Gas	142,783	MWh
Hydro	10,764	MWh
Distillate	-	MWh
Co-Gen	2,291	MWh
SPORE*	382	MWh
EGAT*	(610)	MWh

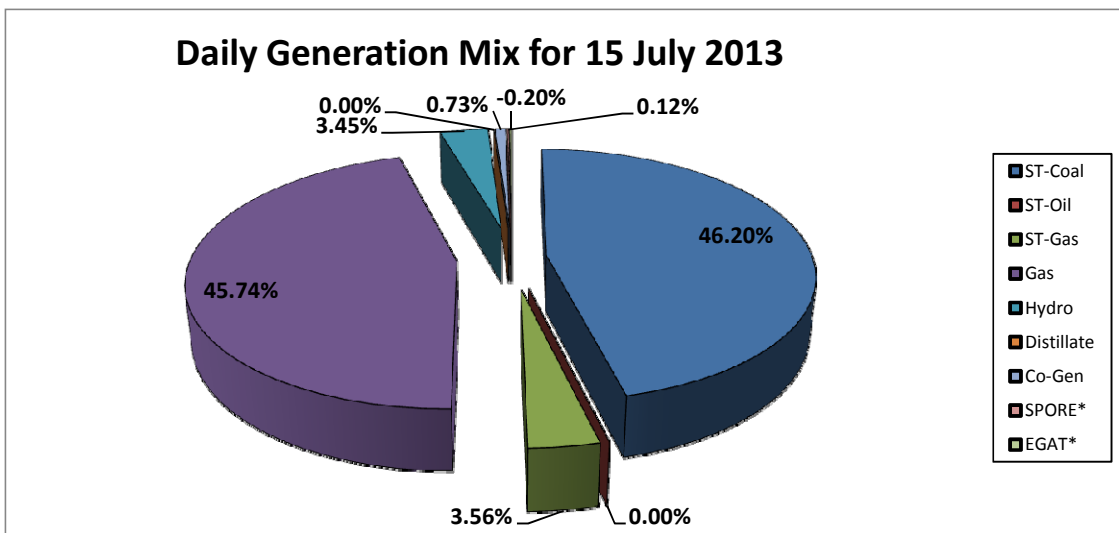

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand