

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE
Maximum Demand for 16 July 2013	15,199 MW	15,201 MW	0.01%
Energy Demand for 16 July 2013	318.35 GWh	317.14 GWh	-0.38%
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62% *New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18% *New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

17-Jul-13


Daily Owners' Mix for 16 July 2013

TNB	61,945 MWh
IPP	252,592 MWh
Co-Gen	2,173 MWh
Interconnection*	(427) MWh

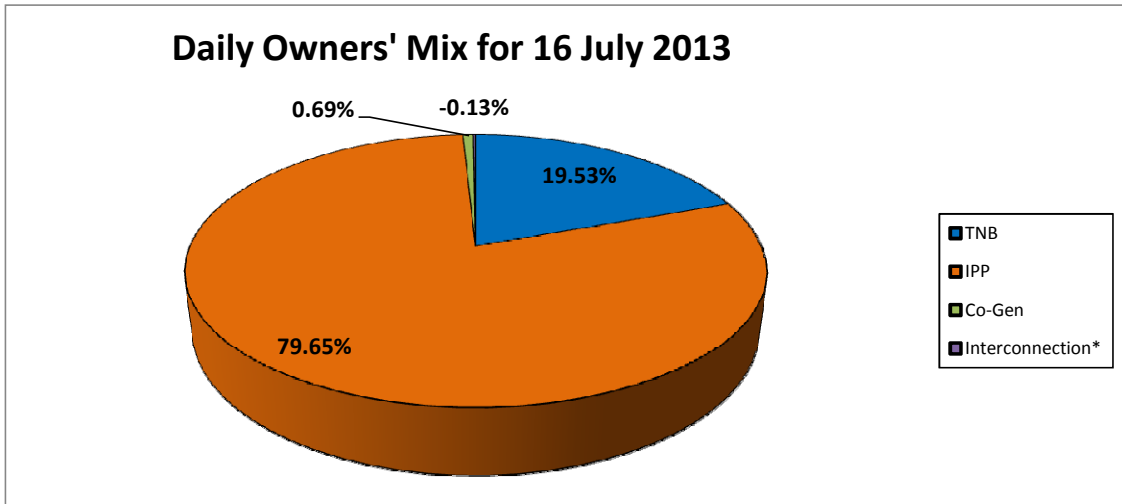

Daily Generation Mix for 16 July 2013

ST-Coal	148,915 MWh
ST-Oil	- MWh
ST-Gas	10,626 MWh
Gas	144,653 MWh
Hydro	10,343 MWh
Distillate	- MWh
Co-Gen	2,173 MWh
SPORE*	271 MWh
EGAT*	(698) MWh

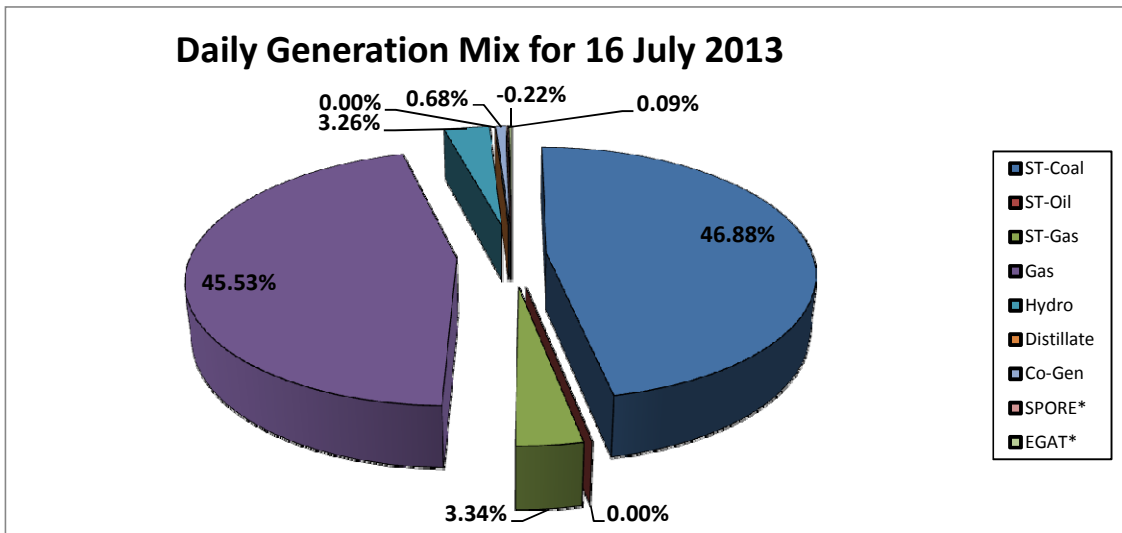

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand