

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 20 July 2013	13,318 MW	13,872 MW	4.16%	
Energy Demand for 20 July 2013	297.46 GWh	304.04 GWh	2.21%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

21-Jul-13


Daily Owners' Mix for 20 July 2013

TNB	59,967 MWh
IPP	241,150 MWh
Co-Gen	2,133 MWh
Interconnection*	(790) MWh

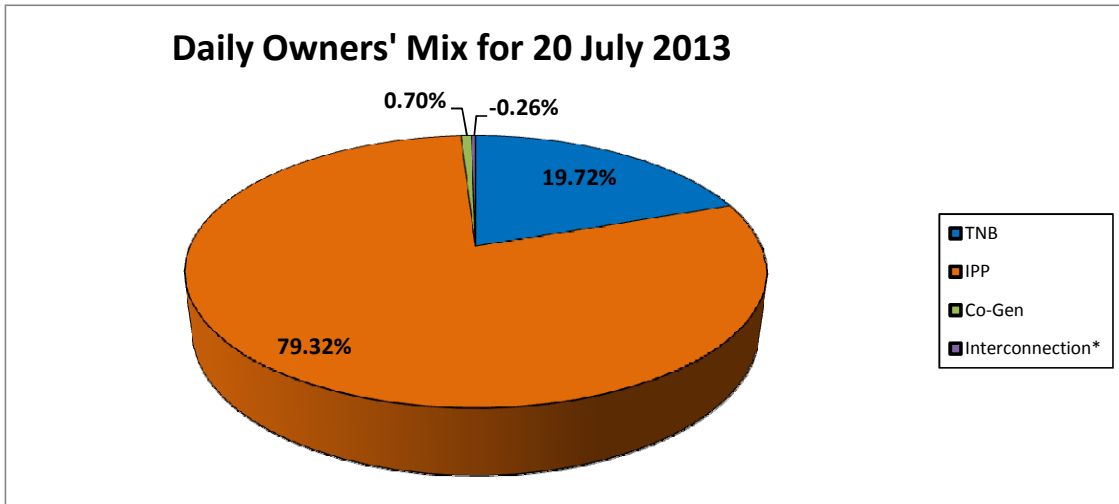

Daily Generation Mix for 20 July 2013

ST-Coal	141,436 MWh
ST-Oil	- MWh
ST-Gas	158 MWh
Gas	142,865 MWh
Hydro	16,658 MWh
Distillate	- MWh
Co-Gen	2,133 MWh
SPORE*	(93) MWh
EGAT*	(697) MWh

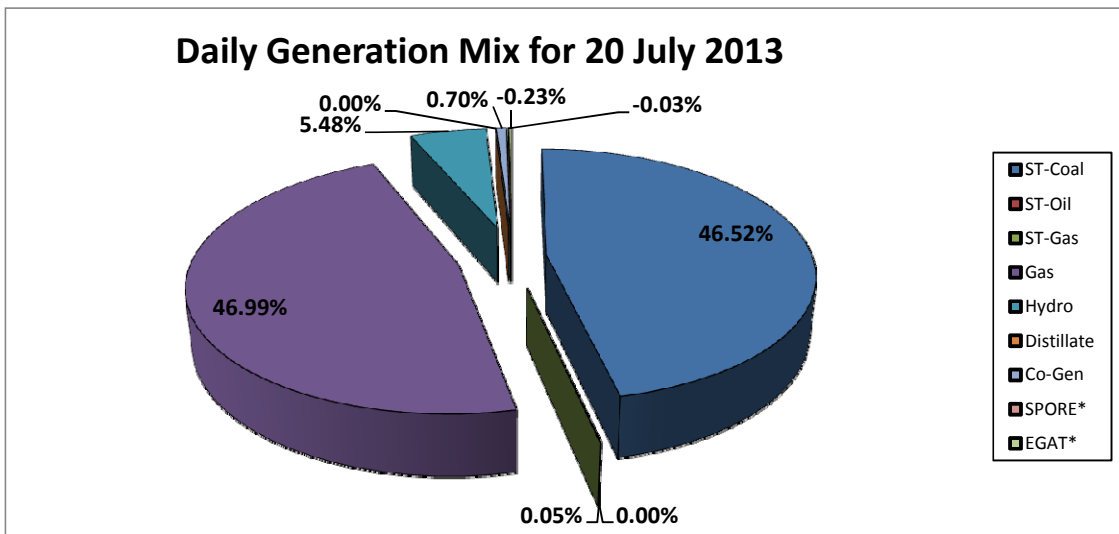

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand