

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 25 July 2013	15,634 MW	15,763 MW	0.83%	
Energy Demand for 25 July 2013	329.76 GWh	329.88 GWh	0.04%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

26-Jul-13


Daily Owners' Mix for 25 July 2013

TNB	68,164 MWh
IPP	260,579 MWh
Co-Gen	2,242 MWh
Interconnection*	1,104 MWh

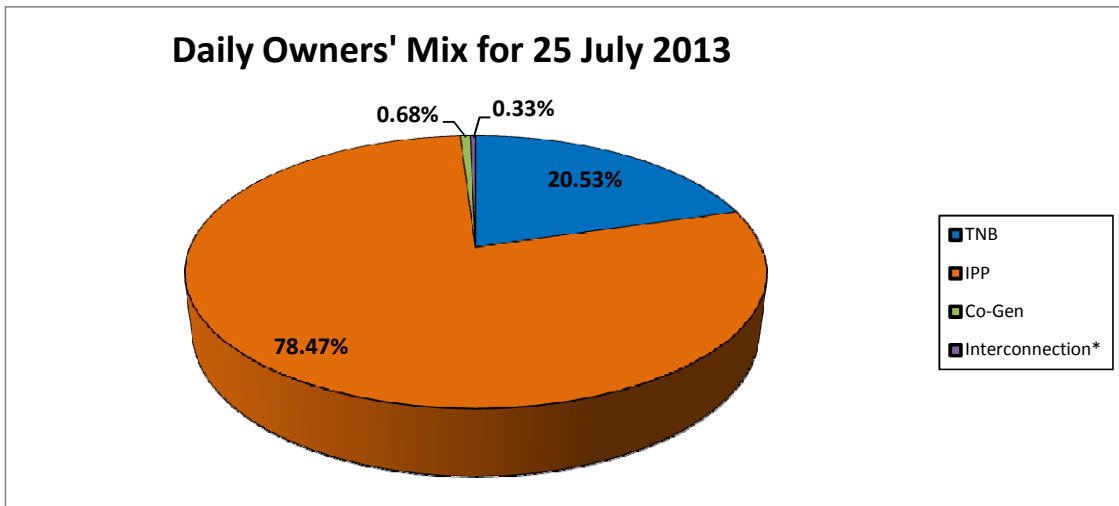

Daily Generation Mix for 25 July 2013

ST-Coal	137,176 MWh
ST-Oil	- MWh
ST-Gas	11,249 MWh
Gas	165,084 MWh
Hydro	15,234 MWh
Distillate	- MWh
Co-Gen	2,242 MWh
SPORE*	380 MWh
EGAT*	724 MWh

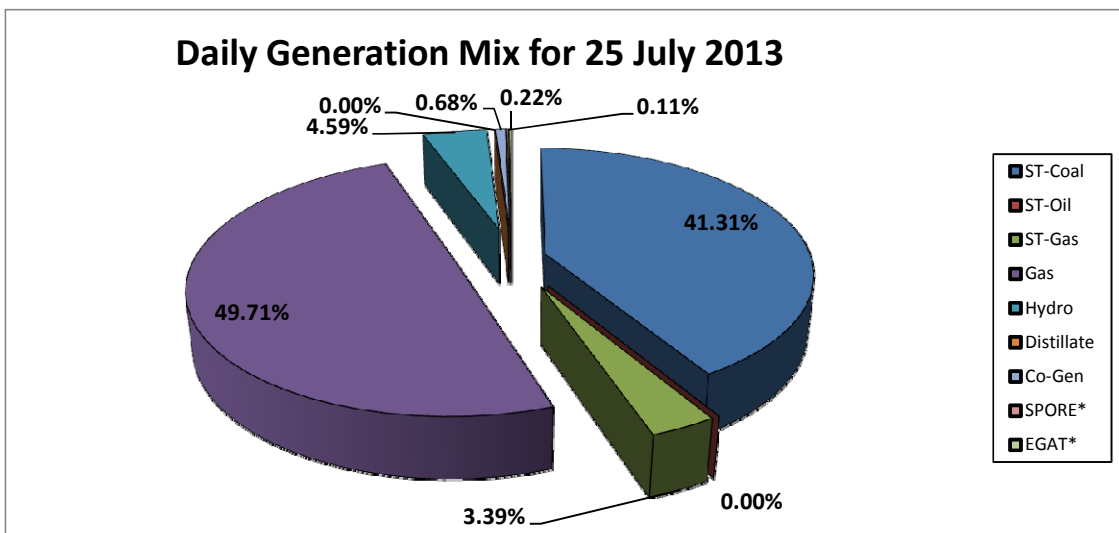

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand