

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 26 July 2013	13,802 MW	13,968 MW	1.20%	
Energy Demand for 26 July 2013	312.67 GWh	311.12 GWh	-0.50%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

27-Jul-13


Daily Owners' Mix for 26 July 2013

TNB	61,123 MWh
IPP	248,496 MWh
Co-Gen	2,251 MWh
Interconnection*	692 MWh

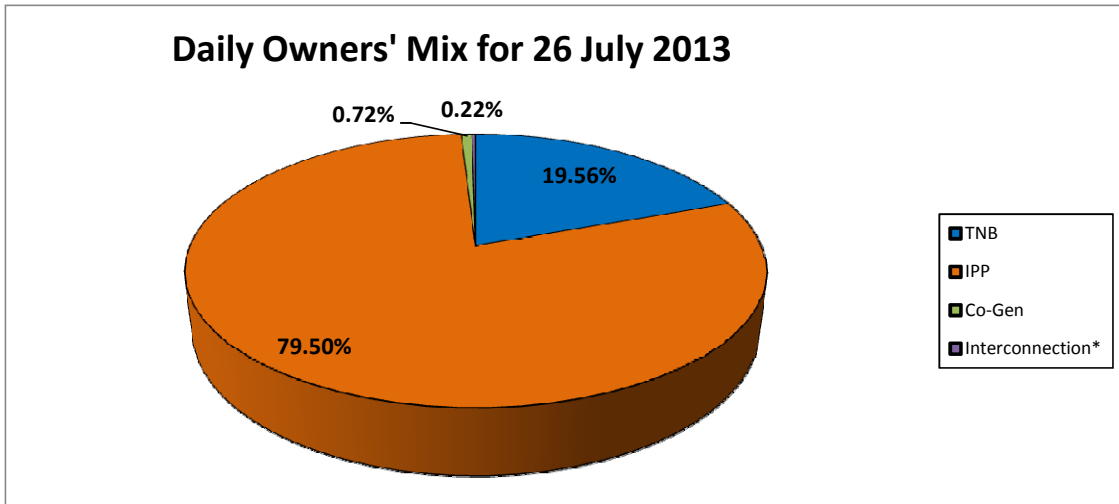

Daily Generation Mix for 26 July 2013

ST-Coal	136,574 MWh
ST-Oil	- MWh
ST-Gas	9,047 MWh
Gas	150,536 MWh
Hydro	13,462 MWh
Distillate	- MWh
Co-Gen	2,251 MWh
SPORE*	(34) MWh
EGAT*	726 MWh

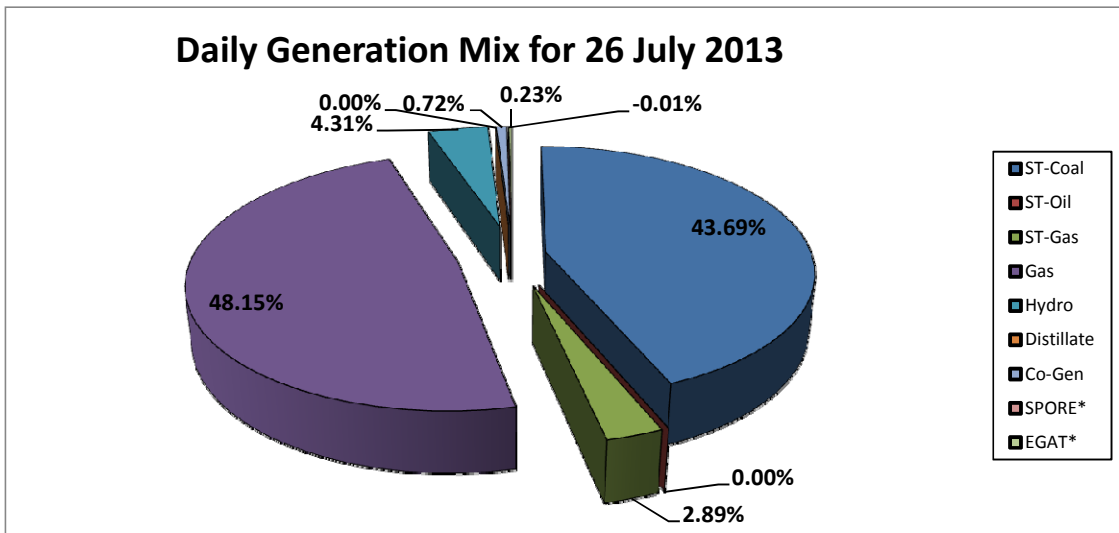

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand