

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE
Maximum Demand for 30 July 2013	15,565 MW	15,586 MW	0.13%
Energy Demand for 30 July 2013	328.05 GWh	327.44 GWh	-0.19%
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62% *New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18% *New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

31-Jul-13


Daily Owners' Mix for 30 July 2013

TNB	64,046 MWh
IPP	262,198 MWh
Co-Gen	1,971 MWh
Interconnection*	780 MWh

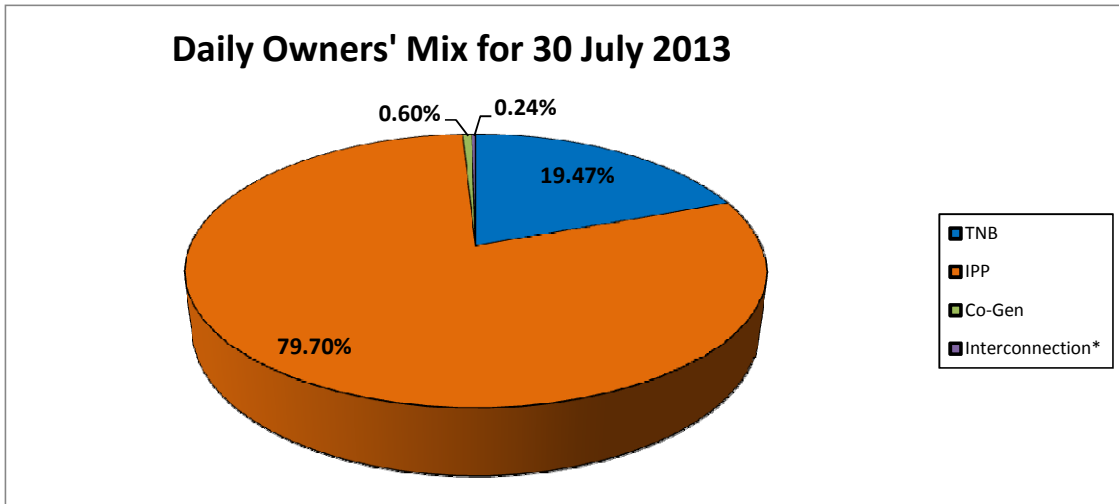

Daily Generation Mix for 30 July 2013

ST-Coal	137,185 MWh
ST-Oil	- MWh
ST-Gas	11,790 MWh
Gas	159,320 MWh
Hydro	17,949 MWh
Distillate	- MWh
Co-Gen	1,971 MWh
SPORE*	55 MWh
EGAT*	725 MWh

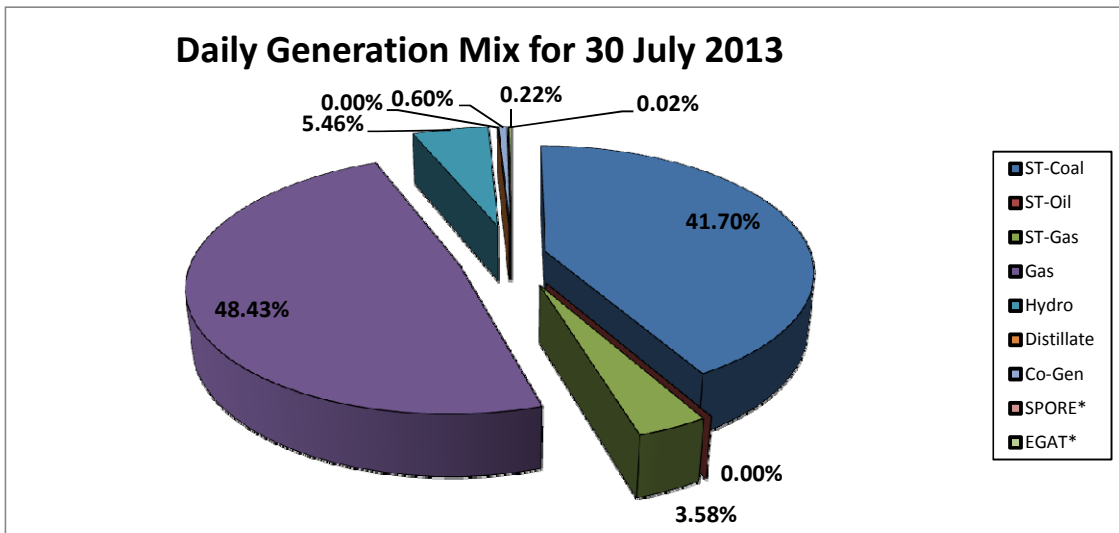

*Negative = energy is imported from Singapore and Thailand

Positive = energy is exported to Singapore and Thailand