


GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 9 August 2013	10,630 MW	10,649 MW	0.18%	
Energy Demand for 9 August 2013	220.63 GWh	219.68 GWh	-0.43%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:
Electricity Market Operations
Electricity Supply & Market Regulations Dept.
Energy Commission Malaysia
10-Aug-13


Daily Owners' Mix for 9 August 2013

TNB	41,540 MWh
IPP	174,749 MWh
Co-Gen	2,108 MWh
Interconnection*	(1,284) MWh

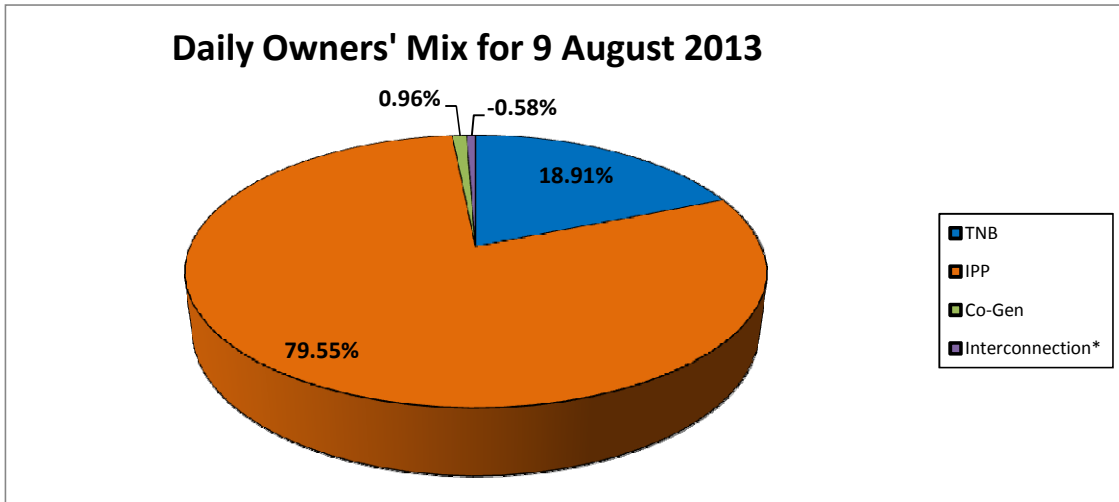

Daily Generation Mix for 9 August 2013

ST-Coal	81,454 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	124,950 MWh
Hydro	9,885 MWh
Distillate	- MWh
Co-Gen	2,108 MWh
SPORE*	(589) MWh
EGAT*	(695) MWh

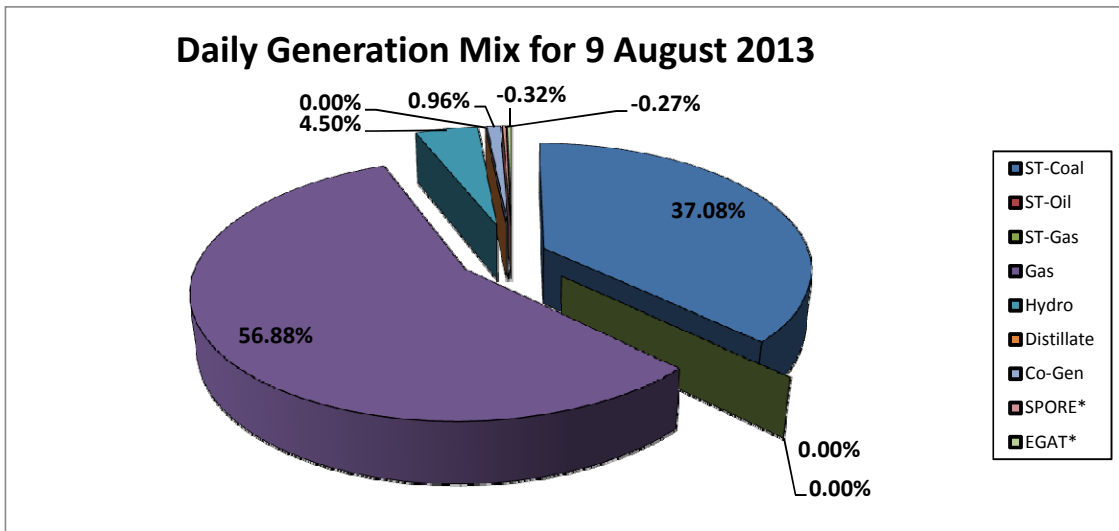

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand