

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 16 August 2013	15,363 MW	15,361 MW	-0.01%	
Energy Demand for 16 August 2013	321.27 GWh	321.11 GWh	-0.05%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

17-Aug-13


Daily Owners' Mix for 16 August 2013

TNB	57,061 MWh
IPP	264,103 MWh
Co-Gen	2,201 MWh
Interconnection*	2,260 MWh

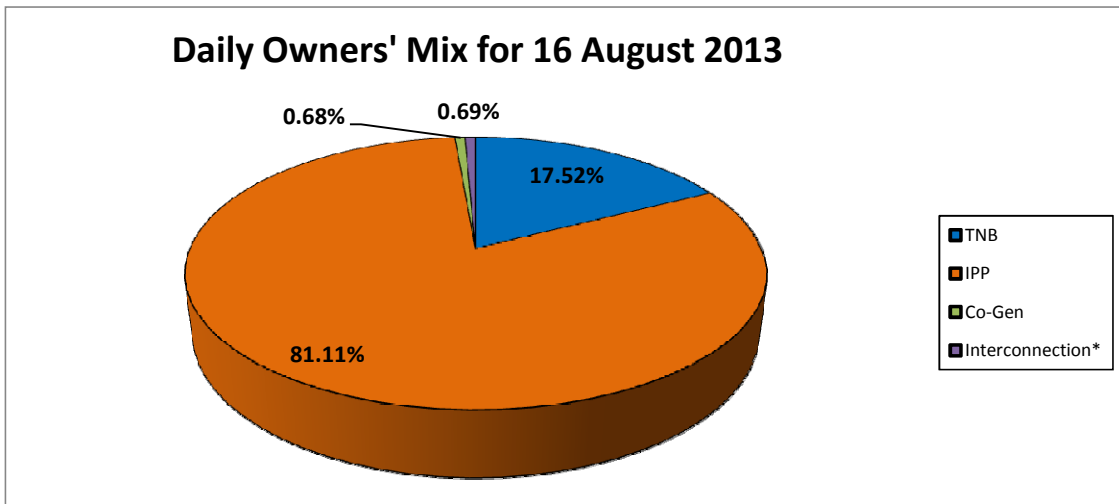

Daily Generation Mix for 16 August 2013

ST-Coal	162,312 MWh
ST-Oil	877 MWh
ST-Gas	8,391 MWh
Gas	135,672 MWh
Hydro	13,912 MWh
Distillate	- MWh
Co-Gen	2,201 MWh
SPORE*	440 MWh
EGAT*	1,820 MWh

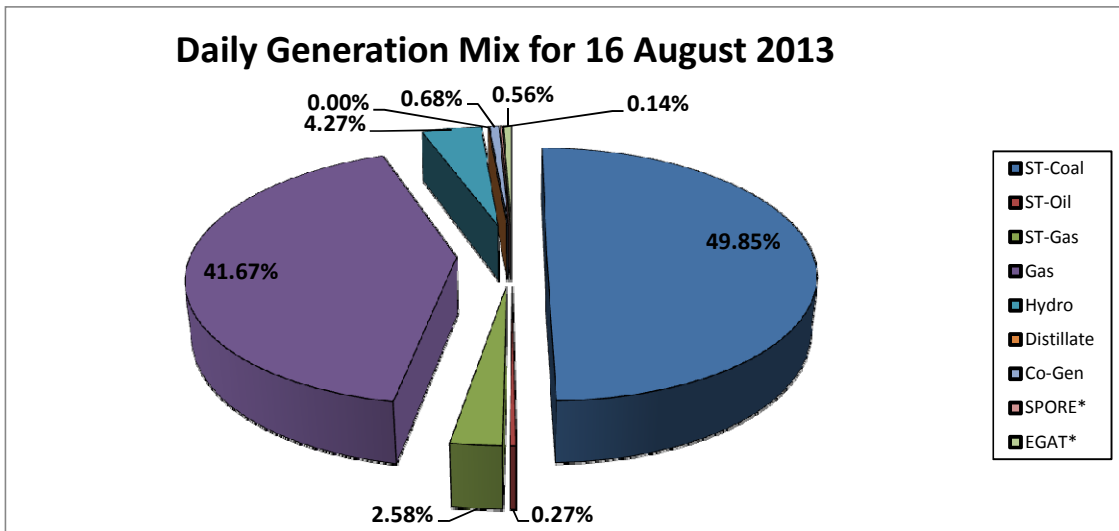

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand