

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 21 August 2013	15,374 MW	15,578 MW	1.33%	
Energy Demand for 21 August 2013	320.96 GWh	323.90 GWh	0.92%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

22-Aug-13


Daily Owners' Mix for 21 August 2013

TNB	60,330 MWh
IPP	261,325 MWh
Co-Gen	1,309 MWh
Interconnection*	(933) MWh

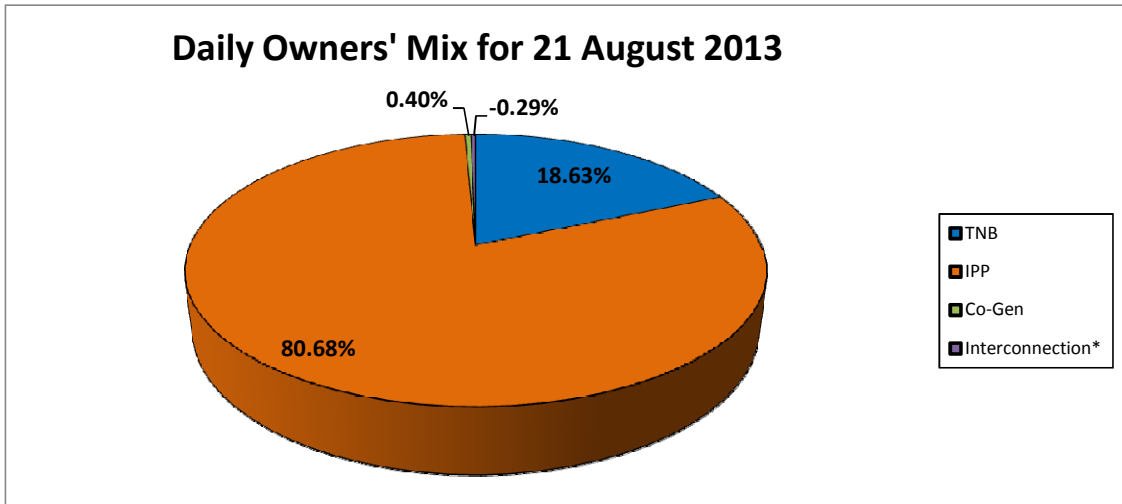

Daily Generation Mix for 21 August 2013

ST-Coal	147,865 MWh
ST-Oil	- MWh
ST-Gas	10,893 MWh
Gas	147,919 MWh
Hydro	14,978 MWh
Distillate	- MWh
Co-Gen	1,309 MWh
SPORE*	(230) MWh
EGAT*	(703) MWh

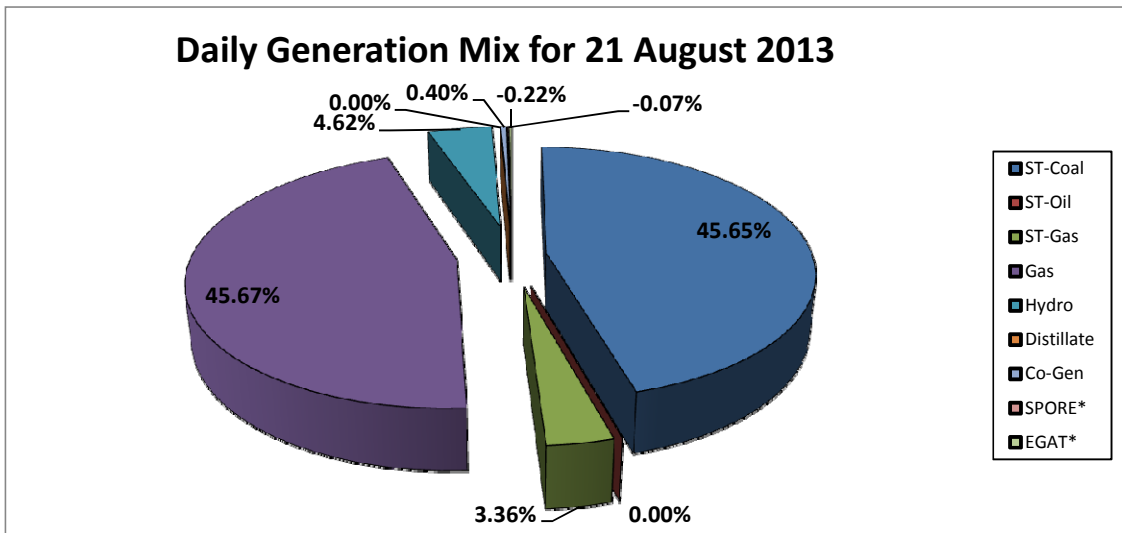

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand