

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 31 August 2013	12,741 MW	12,168 MW	-4.50%	
Energy Demand for 31 August 2013	274.26 GWh	261.49 GWh	-4.66%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

01-Sep-13


Daily Owners' Mix for 31 August 2013

TNB	54,404 MWh
IPP	206,800 MWh
Co-Gen	1,444 MWh
Interconnection*	1,154 MWh

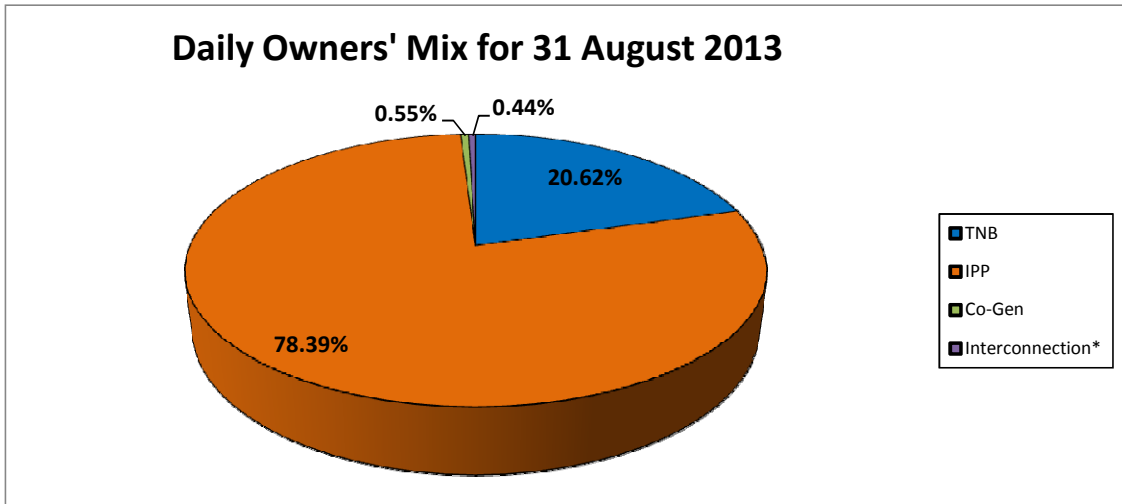

Daily Generation Mix for 31 August 2013

ST-Coal	114,154 MWh
ST-Oil	535 MWh
ST-Gas	4,653 MWh
Gas	126,602 MWh
Hydro	14,531 MWh
Distillate	729 MWh
Co-Gen	1,444 MWh
SPORE*	431 MWh
EGAT*	723 MWh

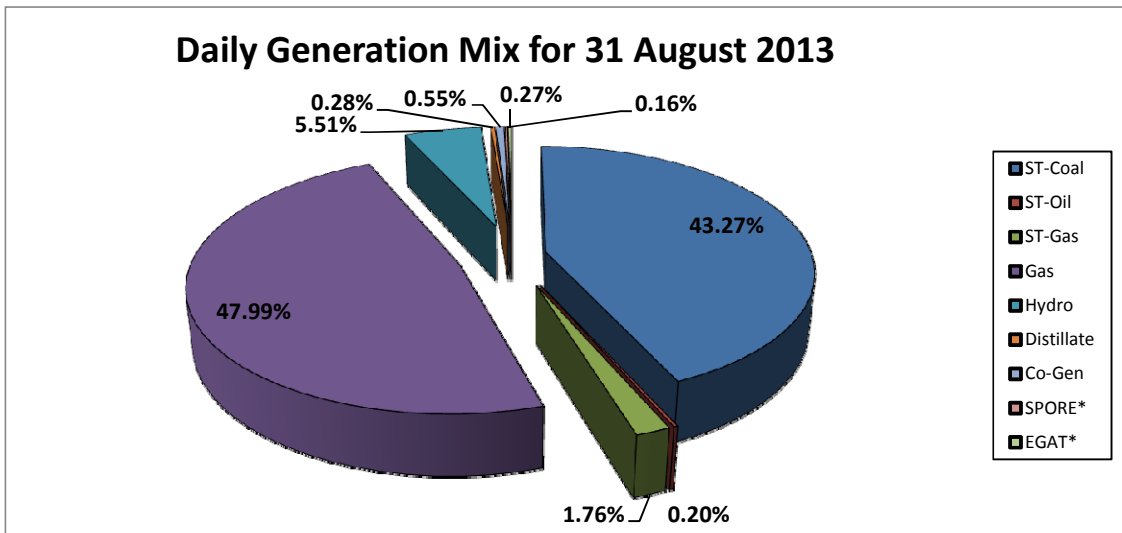

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand