


| EAST COAST GRID | | | | | | | | | | | | | | | | | | | | | | | |
|---------------------------|--|---------|---------|---------|---------|--------|---------|---------|---------|---------|--------|---------|-------|--------|---------|--------|---------|--------|---------|---------|---------|---------|---------|
| INSTALLED CAPACITY | | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 | 417.9 |
| ON LINE CAPACITY | | 116 | 158 | 153.5 | 126.5 | 136.5 | 136.5 | 106 | 106 | 122.8 | 164.1 | 172.1 | 173.1 | 198.1 | 208.1 | 178.3 | 178.3 | 177.3 | 216.1 | 228.1 | 194.1 | 155 | 128 |
| DEMAND | | 198.22 | 209.19 | 204.7 | 201.78 | 207.04 | 209 | 179.69 | 208.48 | 238.17 | 257.44 | 257.83 | 240.9 | 242.38 | 252.27 | 245.72 | 245.15 | 227.74 | 247.12 | 263.79 | 259.87 | 249.48 | 240.54 |
| OPERATING RESERVE | | -82.22 | -51.19 | -51.2 | -75.28 | -70.54 | -72.5 | -73.69 | -102.48 | -115.37 | -93.34 | -85.73 | -67.8 | -44.28 | -44.17 | -67.42 | -66.85 | -50.44 | -31.02 | -35.69 | -39.77 | -55.38 | -85.54 |
| East Cost | | 15630.8 | 20594.8 | 22225.9 | 19081.8 | 20482 | 20521.9 | 14947.5 | 15132.3 | 15811.2 | 20941 | 21872.7 | 20681 | 23812 | 24474.3 | 22909 | 22392.6 | 22291 | 27581.6 | 26023.4 | 27936.5 | 23396.1 | 20695.4 |

EAST COAST GRID OPERATION

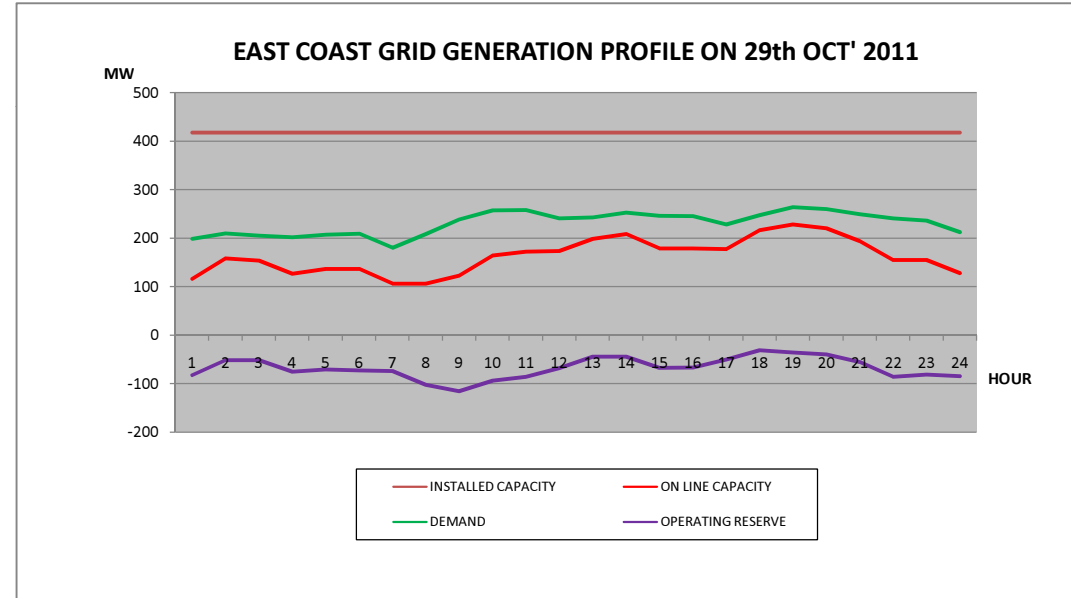

| WEST COAST GRID | | | | | | | | | | | | | | | | | | | | | | | | | |
|---------------------------|--|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|----|
| | | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 |
| INSTALLED CAPACITY | | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | 858.5 | |
| ON LINE CAPACITY | | 538 | 514 | 492 | 492 | 492 | 492 | 557 | 557 | 604.5 | 657.5 | 646.5 | 646.5 | 624.5 | 624.5 | 602.5 | 602.5 | 624.5 | 646.5 | 624.5 | 604.5 | 604.5 | 585.5 | 560 | |
| DEMAND | | 447.3 | 404.2 | 385 | 384.3 | 387.9 | 386.7 | 382.2 | 449.2 | 530.8 | 554.2 | 560.6 | 545.6 | 510.1 | 529.4 | 527.2 | 524.3 | 503.5 | 509.7 | 557.5 | 543.7 | 538.2 | 530.1 | 500.3 | |
| OPERATING RESERVE | | 90.7 | 109.8 | 107 | 107.7 | 104.1 | 105.3 | 174.8 | 107.8 | 73.7 | 103.3 | 85.9 | 100.9 | 114.4 | 95.1 | 75.3 | 78.2 | 99 | 114.8 | 89 | 80.8 | 66.3 | 74.4 | 85.2 | |
| West Cost | | 34786 | 31169 | 30649 | 30552 | 30757 | 30566 | 32542 | 36233 | 41753 | 45455 | 45915 | 44917 | 41880 | 43165 | 43378 | 43133 | 41471 | 43685 | 45585 | 43977 | 42701 | 42096 | 38558 | |

WEST COAST GRID OPERATION

