

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE
Maximum Demand for 5 September 2013	14,999 MW	14,925 MW	-0.49%
Energy Demand for 5 September 2013	315.42 GWh	313.84 GWh	-0.50%
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%

*New MD
*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

06-Sep-13


Daily Owners' Mix for 5 September 2013

TNB	58,605 MWh
IPP	252,784 MWh
Co-Gen	1,451 MWh
Interconnection*	(523) MWh

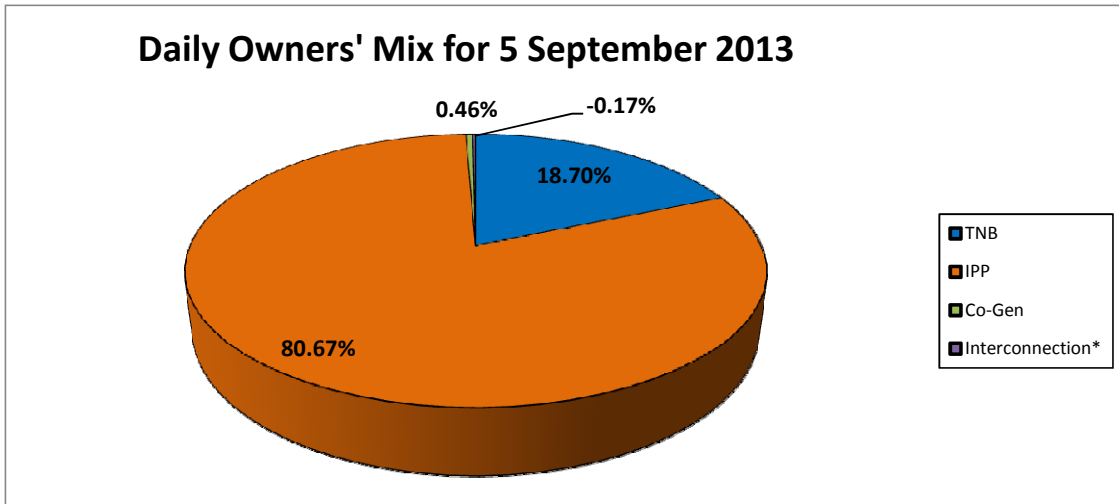

Daily Generation Mix for 5 September 2013

ST-Coal	131,395 MWh
ST-Oil	- MWh
ST-Gas	5,199 MWh
Gas	160,722 MWh
Hydro	14,073 MWh
Distillate	- MWh
Co-Gen	1,451 MWh
SPORE*	172 MWh
EGAT*	(695) MWh

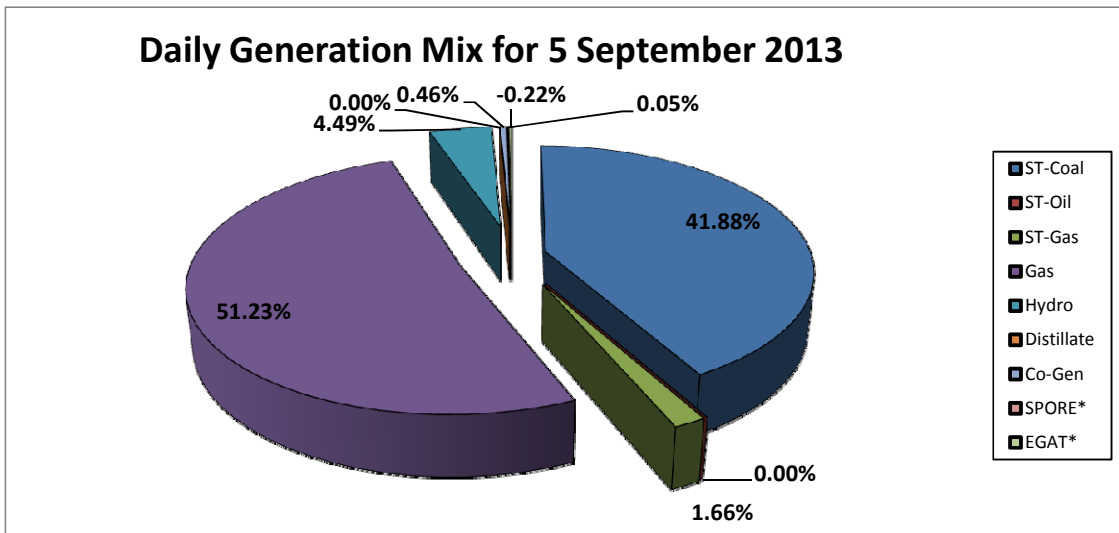

*Negative = energy is imported from Singapore and Thailand

Positive = energy is exported to Singapore and Thailand