

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE
Maximum Demand for 16 September 2013	13,025 MW	12,766 MW	-1.99%
Energy Demand for 16 September 2013	277.04 GWh	261.41 GWh	-5.64%
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%

*New MD
*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

17-Sep-13


Daily Owners' Mix for 16 September 2013

TNB	47,632	MWh
IPP	212,582	MWh
Co-Gen	1,098	MWh
Interconnection*	(93)	MWh

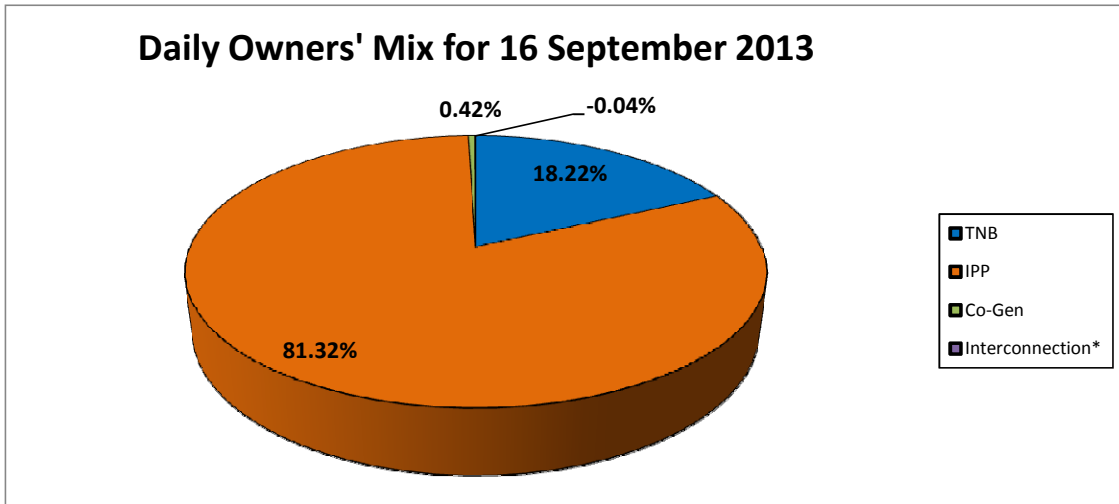

Daily Generation Mix for 16 September 2013

ST-Coal	119,201	MWh
ST-Oil	-	MWh
ST-Gas	-	MWh
Gas	133,920	MWh
Hydro	7,093	MWh
Distillate	-	MWh
Co-Gen	1,098	MWh
SPORE*	74	MWh
EGAT*	(167)	MWh

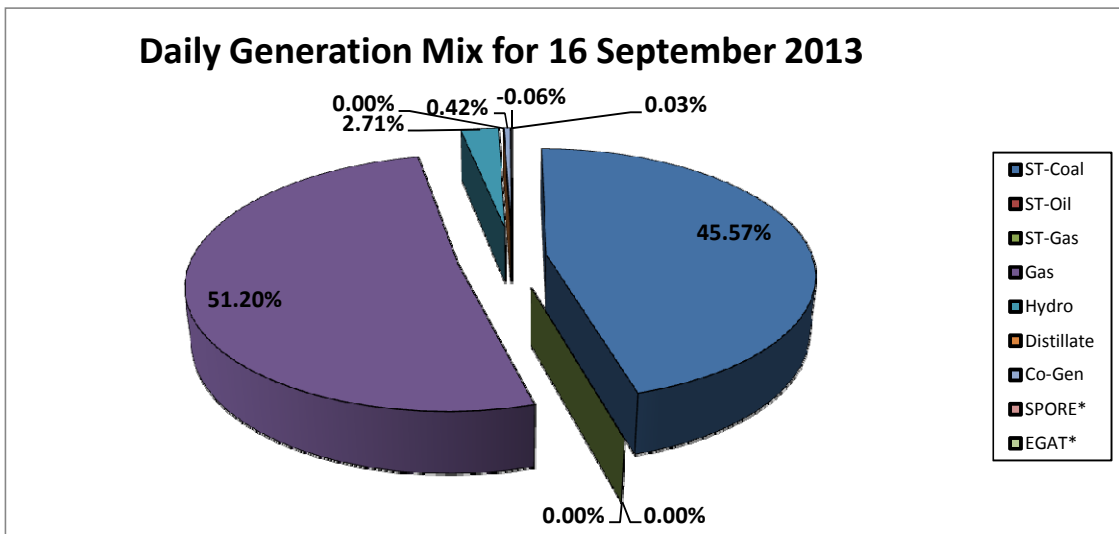

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand