

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 22 September 2013	13,079 MW	13,671 MW	4.53%	
Energy Demand for 22 September 2013	281.51 GWh	287.95 GWh	2.29%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

23-Sep-13


Daily Owners' Mix for 22 September 2013

TNB	50,672 MWh
IPP	236,031 MWh
Co-Gen	1,097 MWh
Interconnection*	(146) MWh

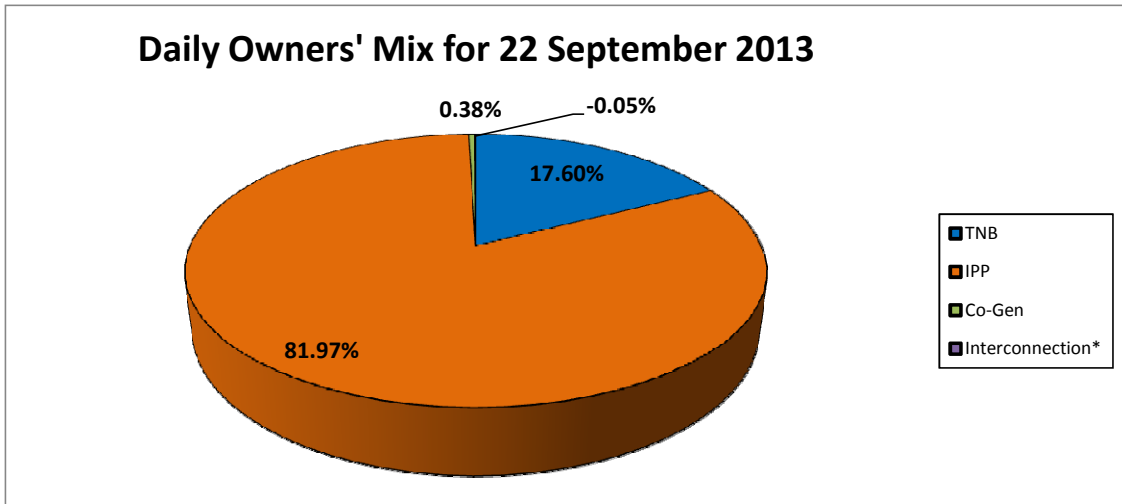

Daily Generation Mix for 22 September 2013

ST-Coal	126,264 MWh
ST-Oil	- MWh
ST-Gas	4,976 MWh
Gas	138,606 MWh
Hydro	16,831 MWh
Distillate	- MWh
Co-Gen	1,097 MWh
SPORE*	253 MWh
EGAT*	(399) MWh

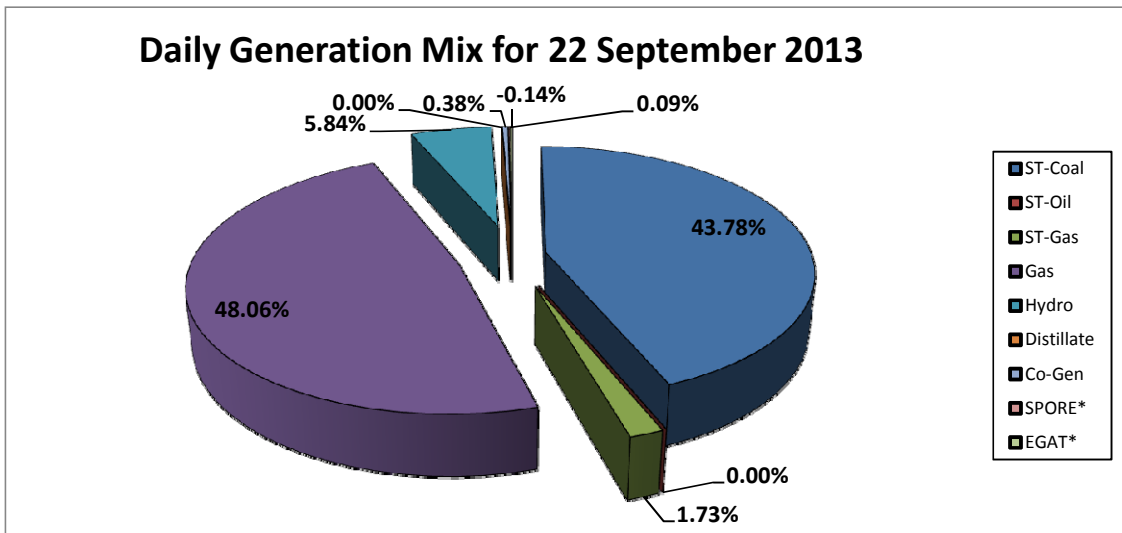

*Negative = energy is imported from Singapore and Thailand

Positive = energy is exported to Singapore and Thailand