

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)


	FORECAST	ACTUAL	VARIANCE
Maximum Demand for 28 September 2013	14,024 MW	14,045 MW	0.15%
Energy Demand for 28 September 2013	307.26 GWh	304.24 GWh	-0.98%
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%

*New MD
*New Energy

Prepared by:
Electricity Market Operations
Electricity Supply & Market Regulations Dept.
Energy Commission Malaysia
29-Sep-13


Daily Owners' Mix for 28 September 2013

TNB	57,578	MWh
IPP	246,712	MWh
Co-Gen	1,093	MWh
Interconnection*	1,139	MWh

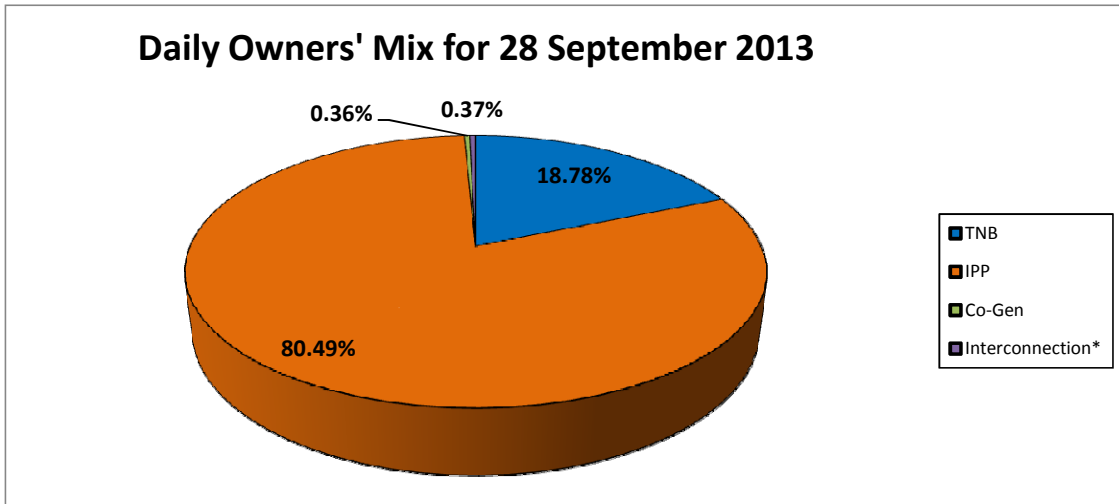

Daily Generation Mix for 28 September 2013

ST-Coal	144,106	MWh
ST-Oil	-	MWh
ST-Gas	125	MWh
Gas	145,240	MWh
Hydro	14,819	MWh
Distillate	-	MWh
Co-Gen	1,093	MWh
SPORE*	41	MWh
EGAT*	1,098	MWh

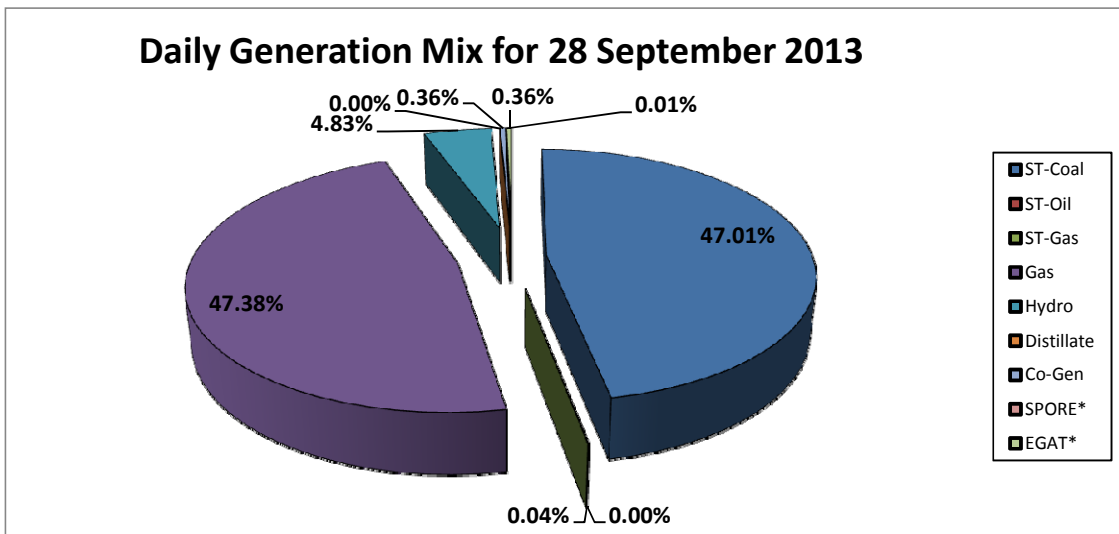

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand