

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 30 September 2013	15,677 MW	15,646 MW	-0.20%	
Energy Demand for 30 September 2013	322.61 GWh	321.15 GWh	-0.45%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

01-Oct-13


Daily Owners' Mix for 30 September 2013

TNB	62,083 MWh
IPP	259,076 MWh
Co-Gen	1,040 MWh
Interconnection*	1,052 MWh

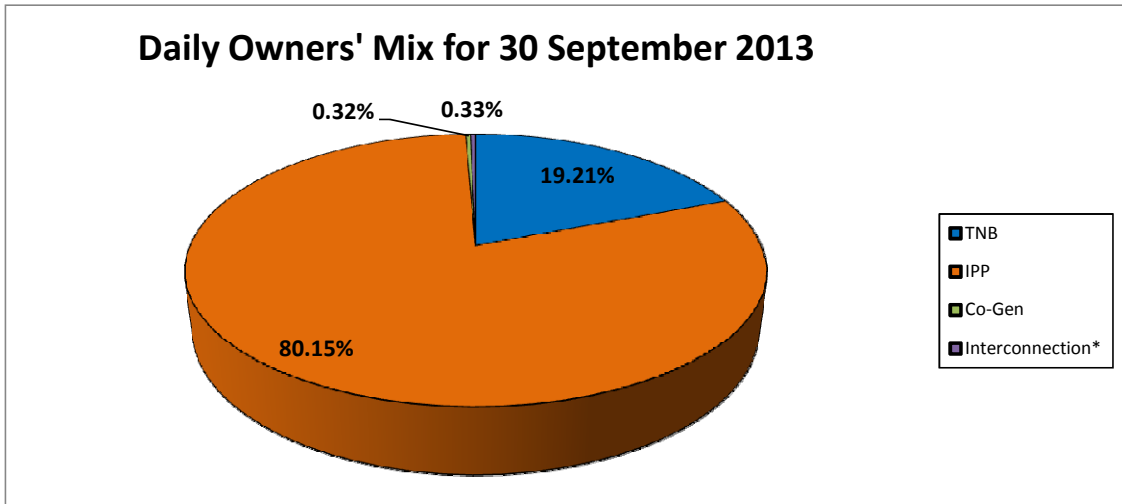

Daily Generation Mix for 30 September 2013

ST-Coal	148,281 MWh
ST-Oil	- MWh
ST-Gas	8,161 MWh
Gas	149,792 MWh
Hydro	14,925 MWh
Distillate	- MWh
Co-Gen	1,040 MWh
SPORE*	50 MWh
EGAT*	1,002 MWh

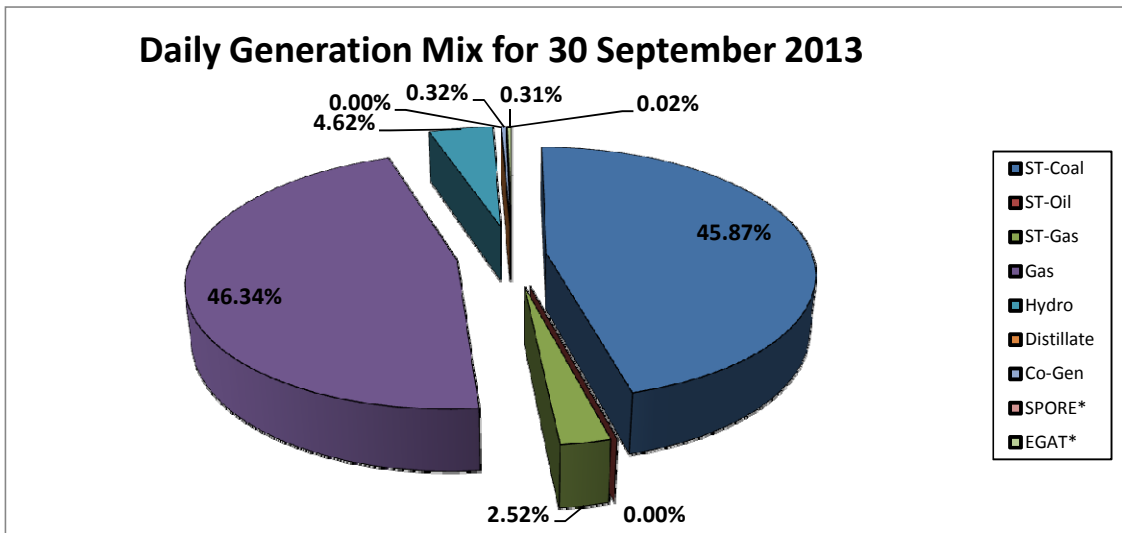

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand