

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 3 November 2013	12,710 MW	12,303 MW	-3.20%	
Energy Demand for 3 November 2013	268.19 GWh	260.43 GWh	-2.89%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

04-Nov-13


Daily Owners' Mix for 3 November 2013

TNB	71,187 MWh
IPP	186,245 MWh
Co-Gen	2,014 MWh
Interconnection*	(983) MWh

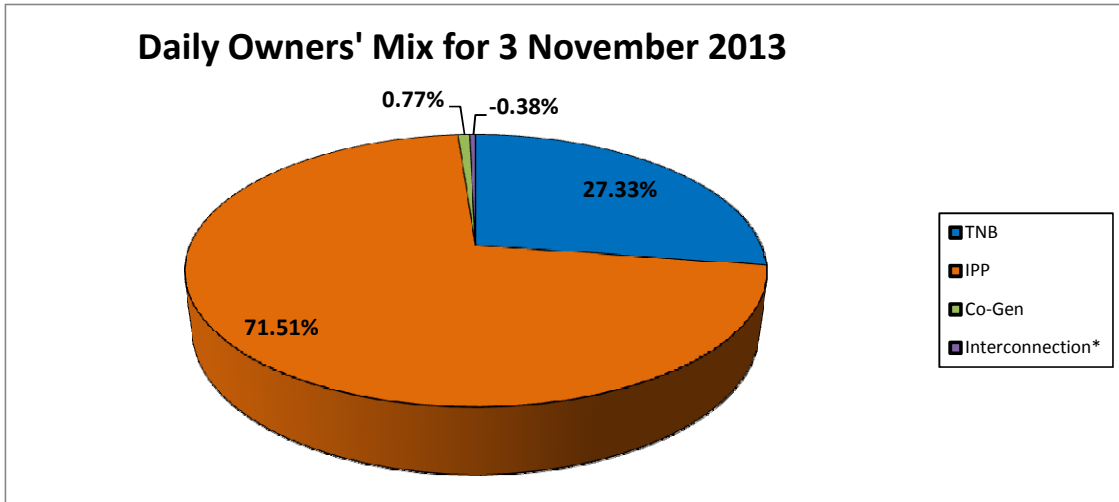

Daily Generation Mix for 3 November 2013

ST-Coal	109,662 MWh
ST-Oil	- MWh
ST-Gas	10,970 MWh
Gas	127,199 MWh
Hydro	9,601 MWh
Distillate	- MWh
Co-Gen	2,014 MWh
SPORE*	(282) MWh
EGAT*	(701) MWh

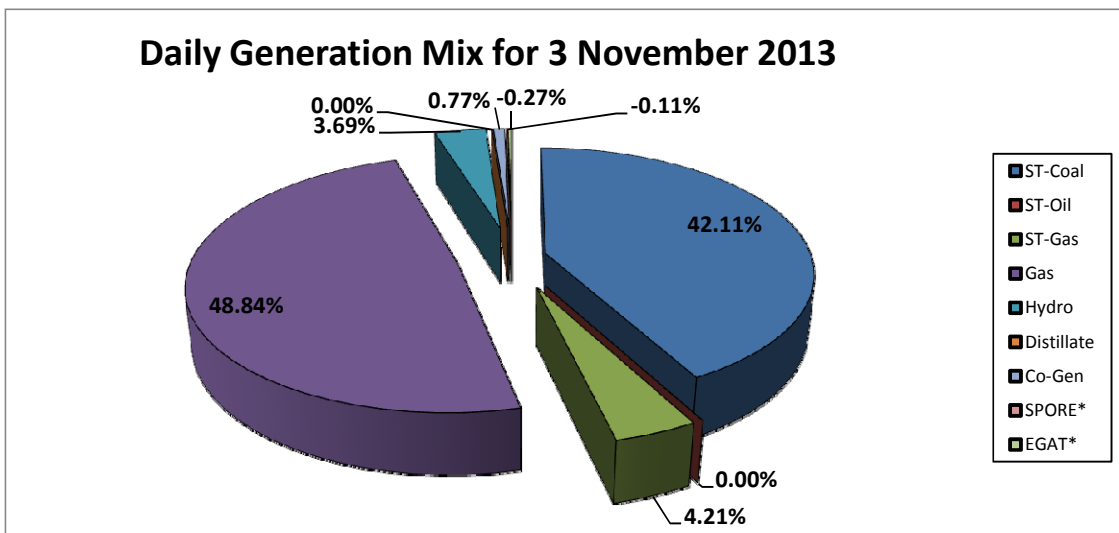

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand