

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 16 November 2013	13,717 MW	13,738 MW	0.15%	
Energy Demand for 16 November 2013	300.18 GWh	301.16 GWh	0.33%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

17-Nov-13


Daily Owners' Mix for 16 November 2013

TNB	80,804 MWh
IPP	349,977 MWh
Co-Gen	1,900 MWh
Interconnection*	(734) MWh

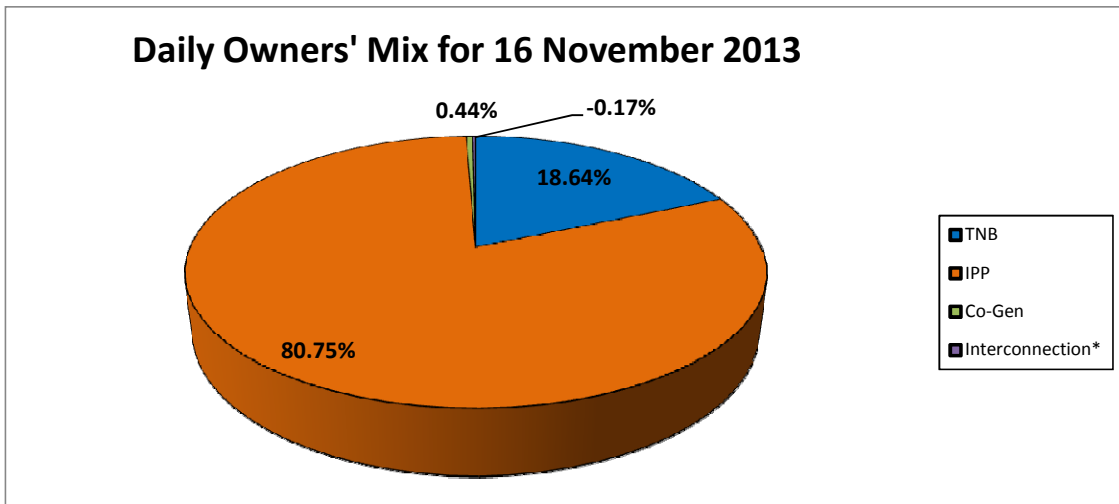

Daily Generation Mix for 16 November 2013

ST-Coal	106,073 MWh
ST-Oil	- MWh
ST-Gas	11,988 MWh
Gas	163,702 MWh
Hydro	16,760 MWh
Distillate	- MWh
Co-Gen	1,900 MWh
SPORE*	(38) MWh
EGAT*	(696) MWh

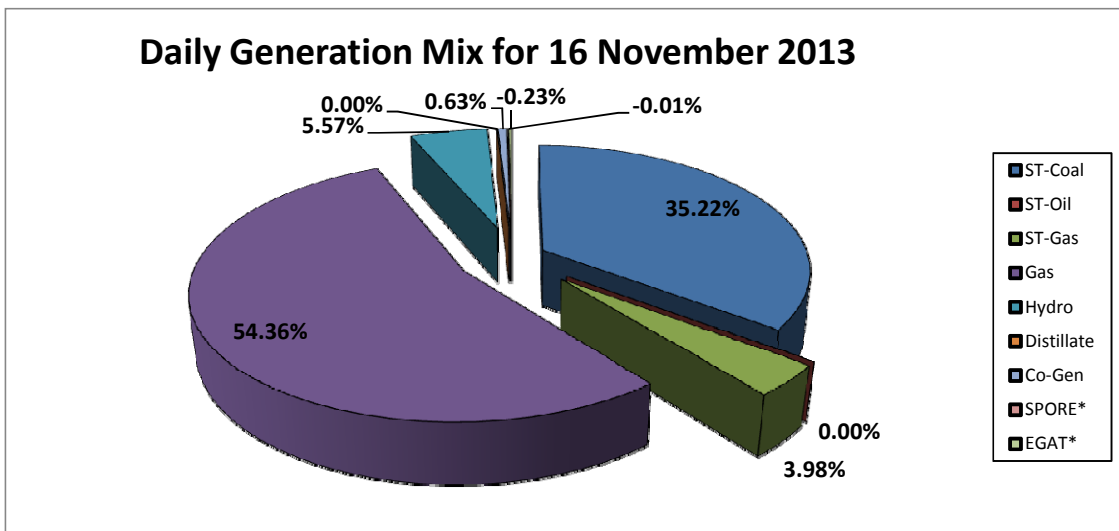

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand