

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)


	FORECAST	ACTUAL	VARIANCE
Maximum Demand for 22 November 2013	14,265 MW	14,363 MW	0.69%
Energy Demand for 22 November 2013	307.98 GWh	307.74 GWh	-0.08%
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%
Highest Daily Energy Demand (25 June 2013)	345.88 GWh	345.25 GWh	-0.18%

*New MD
*New Energy

Prepared by:
Electricity Market Operations
Electricity Supply & Market Regulations Dept.
Energy Commission Malaysia
23-Nov-13


Daily Owners' Mix for 22 November 2013

TNB	72,259 MWh
IPP	232,724 MWh
Co-Gen	1,992 MWh
Interconnection*	(761) MWh

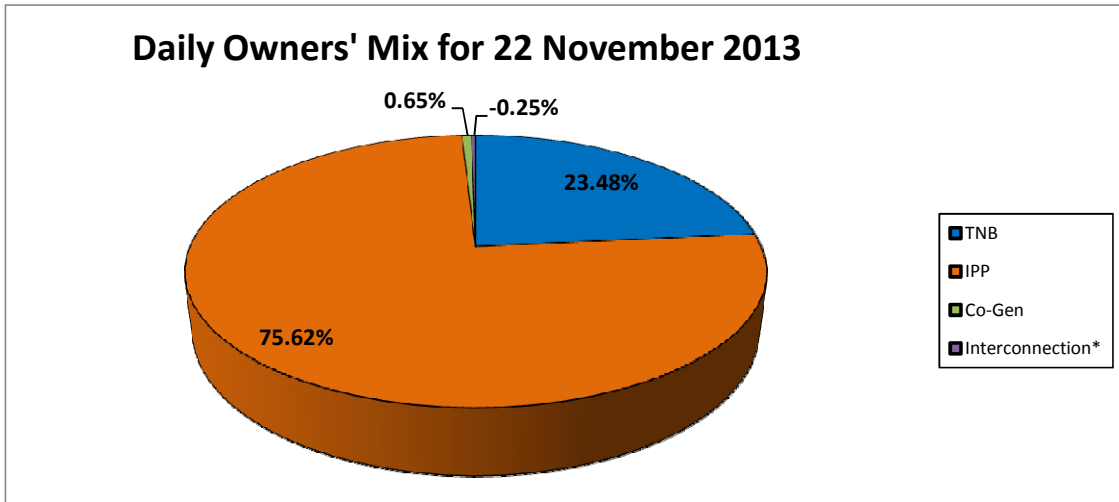

Daily Generation Mix for 22 November 2013

ST-Coal	127,347 MWh
ST-Oil	- MWh
ST-Gas	11,245 MWh
Gas	158,938 MWh
Hydro	7,453 MWh
Distillate	- MWh
Co-Gen	1,992 MWh
SPORE*	(61) MWh
EGAT*	(700) MWh

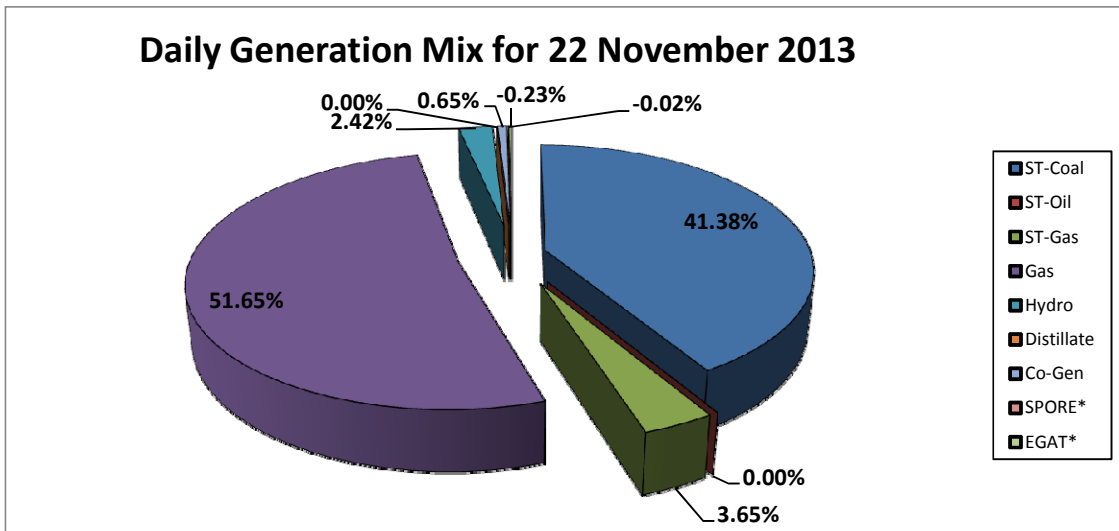

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand